Sound Insulation

According to ISO 140/3

A5

Authorizing Company: ETEM S.A.

Dimensions in mm

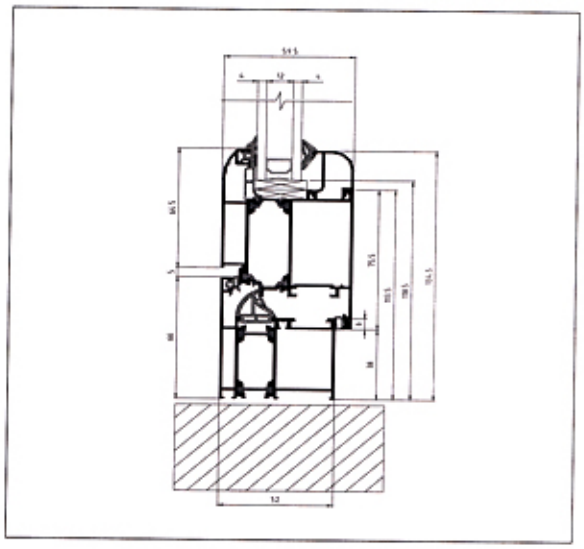

Specimen description:

Single sash side/bottom hung aluminium window E-40 series

Area : 1,9 m²
Total glazing thickness: 20 mm

Layers:

Thermal insulating glazing 4+12+4 mm
Rubber seals between sash frame and glazing
Three rubber seals between sash and frame

Test rooms:

Volumes:
V source = 29,7 m³
V receiving = 43,8 m³

Type of room : Laboratory test room
Room condition: Empty
Excitation : White noise
Filter : 1/3 octave

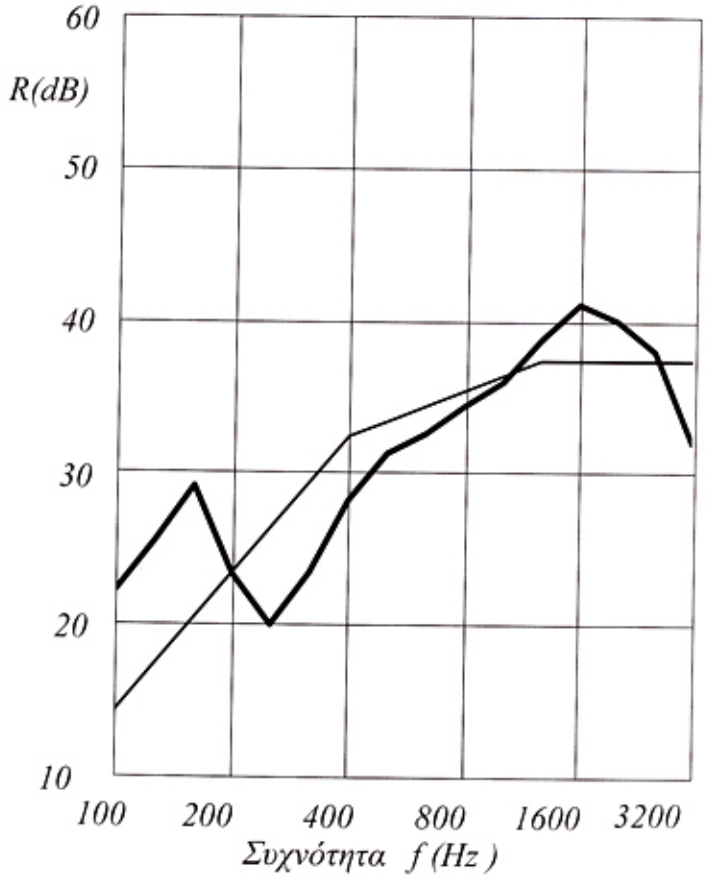

Evaluation according to ISO 717/1

Weighted Sound Reduction Index

$R_W = 34$ dB

f(Hz):	100	**125**	160	200	**250**	315	400	**500**	630	800	**1000**	1250	1600	**2000**	2500	3150
R(dB):	22,9	26,1	29,7	23,9	20,6	24,0	28,8	31,9	33,2	35,0	36,6	39,4	41,7	40,6	38,6	32,6

Test number: A5.332.03

Date of test: 30.06.2003 C

School of Architecture – Faculty of Technology – A.U.T.
Architectural Technology Laboratory
Director: E.Tzekakis

Signature